


PAD-MOUNTED TRANSFORMER LOCATION MAP AND MINIMUM CLEARANCES

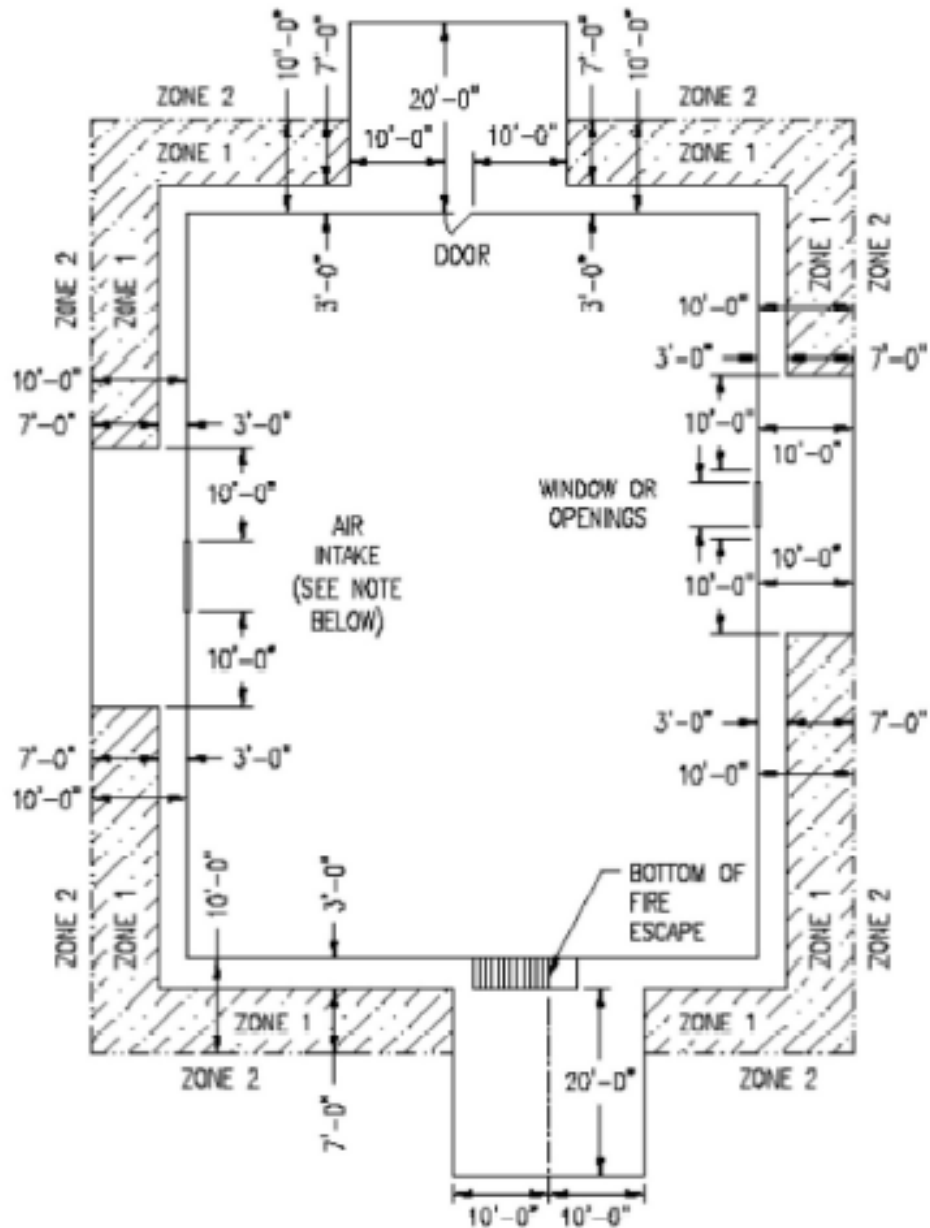

NOTES:

- ZONE 1 (Shaded Area) = Minimum distance for pad-mounted transformer from a non-combustible building.
- ZONE 2 = Minimum distance for pad-mounted transformers from a combustible building.
- Air intake clearance must be a minimum of 25 feet diagonal from transformer (not shown), additional clearances are shown on Minimum Distances for Pad-Mount Transformers drawing.