



Town of Parker Community Development Department  
Development Review Division  
Attention: **Julia Duncan**

Application Type: **Site Plan**  
Status: **First Referral**  
Application Name: Douglas 234 F6 L1 - Gas and Convenience Store  
Case/AP#: **SP21-063**  
Referral Received: June 20, 2021  
Comments Due: July 29, 2021

Application Location: Southeast corner of Chambers Road and Red Sky Drive

Review date: **July 20, 2021**  
Plan reviewer: **Randall L. Capra**, [rcapra@parkeronline.org](mailto:rcapra@parkeronline.org)  
Phone: 303.805.3169

**Narrative:** The applicant, EES, is proposing an approximately 4,100 sq. ft. convenience store with gas. The site is located on the southeast corner of Chambers Road and Red Sky Drive. In addition to the convenience store, the applicant will be constructing a car wash on lot 2; this scope of work can be found under SP21-064

**Code Reference:** 2018 International Fire Code, 2018 International Building Code, 2017 NEC (*adopted codes valid through Dec 31, 2021; project submitted after December 31, 2021 must be designed to the 2021 ICC codes and the 2020 NEC*).

**TOWN OF PARKER - FIRE/LIFE SAFETY:**

**C REVIEWED FOR CODE COMPLIANCE w/COMMENTS**


- 1<sup>st</sup> Submittal – Reviewed July 20, 2021
- 2<sup>nd</sup> Submittal – Reviewed October 8, 2021 (*Comments in red, italicized font*)
- 3<sup>rd</sup> Submittal – Reviewed December 14, 2021 (*Comments in bold, red, italicized font*)
- 4<sup>th</sup> Submittal – Reviewed January 24, 2022 (*Comments in bold, red, italicized font with a yellow highlight*)

## UNRESOLVED ISSUES/COMMENTS

1. The applicant shall be aware that the Town of Parker has officially adopted the 2018 ICC codes as of January 1, 2019; all submittal documents are required to comply with the 2018 ICC codes. Note – The Town of Parker will have officially adopted the 2021 ICC family on January 1, 2022; the 2020 NEC will be adopted at this time, as well. Any submittals received after December 31, 2021 will be required to meet the newly adopted codes. *Satisfied; applicant has acknowledged this requirement with current submittal.*
2. The applicant shall be aware that no vertical construction on this site will be allowed until such time that curb gutter and first lift of asphalt are installed; a site inspection will be required to ensure that this requirement is made prior to allowing vertical construction to commence. *Satisfied; applicant has acknowledged this requirement with current submittal.*
3. Per the requirements of [18 IFC Section 503.1.1 Buildings and Facilities] approved fire apparatus access roads shall be provided for every facility, building, portion of a building hereafter constructed or moved into or within the jurisdiction. The fire apparatus access road shall comply with the requirements of this section and shall extend to within 150 feet of all portions of the facility and all portions of the exterior walls of the first story of the building as measured by an approved route around the exterior of the building or facility (the building is a 155+ feet long and 50.56 feet wide and cannot meet the requirement as measured from the center line of the fire apparatus as measured by an approved route from any point that a fire engine might park when responding to a call at this building). This submittal does not provide for this requirement of the code. Per the requirements of the code, the fire code official is allowed to increase the dimension of the 150 feet provided that the applicant meets Exception 1.1 of this section... "The building is equipped throughout with an approved automatic sprinkler suppression system installed in accordance with section 903.1.1, 903.1.2, or 903.3.1.3. *Satisfied; applicant has worked through access issues and the building is to be sprinklered per NFPA 13.*

4. The Town of Parker requires that fire apparatus access roads meet the clear-width and weight-bearing standards of the jurisdiction in which the project is located. Roadways shall be designed to support the imposed weight of fire apparatus, 30-ton, two axle and 40-ton three, axle vehicles. An unimpeded clear width of 20-feet shall be maintained at all times. As such, any location where parked vehicles would obstruct this clear width requirement will require “NO PARKING – FIRE LANE” signage. *This signage shall be red on white. Update design criteria has been provided at the end of this document; ensure compliance when resubmitting. Satisfied; applicant has addressed/acknowledged this requirement with current submittal.*
5. The applicant shall provide an auto turn analysis indicating that apparatus can navigate all portions of this site (both sides of the gas canopy); NO PARKING – FIRE LANE signage is required for any portion of the access where the 20-foot clear width requirement cannot be met. This is applicable for the loop around the canopy as well as for each entry. The access on each side of the canopy shall meet his requirement with no portion of the canopy encroaching into the required fire lane access road. See below for the areas required to be included in the auto turn analysis and address when resubmitting: *Not satisfied; applicant has stated that the auto-turn analysis and fire lane signage can be found on the Horizontal Plan in the CD set. In this case, the Horizontal Plan did not include auto-turn analysis for the area shown below in yellow. This issue shall be addressed when resubmitting.*

*What is needed specific to the auto-turn analysis:      What was provided on the Horizontal Control Plan:*

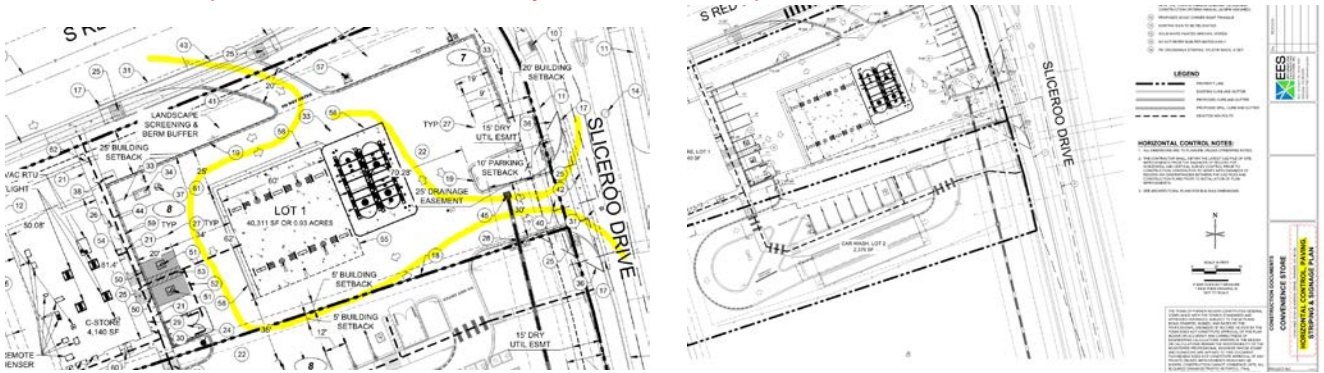

***Not satisfied; the applicant has not addressed this issue with submittal package #3; the applicant is required to respond to this issue prior to Fire Life Safety sign off. Satisfied; applicant has addressed with current submittal.***

6. **Sheet U1.0:** While the applicant has identified the size of the UFL, the applicant shall identify the length of the UFL, as measured from the “T” to the flange in the building. Address this issue on the plan set when resubmitting. *Satisfied; applicant has addressed/acknowledged this requirement with current submittal.*
7. **Sheet U1.0:** While the applicant has included the required fire life safety signature block for Fire Life Safety on the cover page of the utility documents, the applicant has not provided the required fire life safety signature block for Fire Life Safety on the overall utility page. This issue must be addressed when resubmitting. *Satisfied; applicant has addressed/acknowledged this requirement with current submittal.*

Note - An updated signature block has been created with regard to the utility drawing package; typically, this signature block is located on the cover sheet and the overall utility page of the water drawings. The signature block is noted below; address as applicable.

**GENERAL COMMENTS (as applicable)**

All engineering documents submitted to the Town of Parker shall bear the wet signature and seal of the engineer or architect in responsible charge of the design.


Water distribution and site access components shall be installed and in service prior to the construction of any portion of the structure, except by special permit issued by the Fire District.


**Underground fire lines**

When thrust blocks are used as part of the pipe restraint system, submitted plans for permit shall provide detailed documentation that the thrust blocks satisfy all requirements of 13 NFPA 24: 10.8.2, including specific thrust block dimensions and mathematical calculations for block dimensions per guidelines provided in Annex A.10.8.2.

## FIRE ACCESS ROAD DESIGN CRITERIA

**VEHICLE SPECIFICATIONS** are provided for the largest apparatus in use by South Metro Fire Rescue. Fire Apparatus Access Roads shall be capable of accommodating this apparatus.

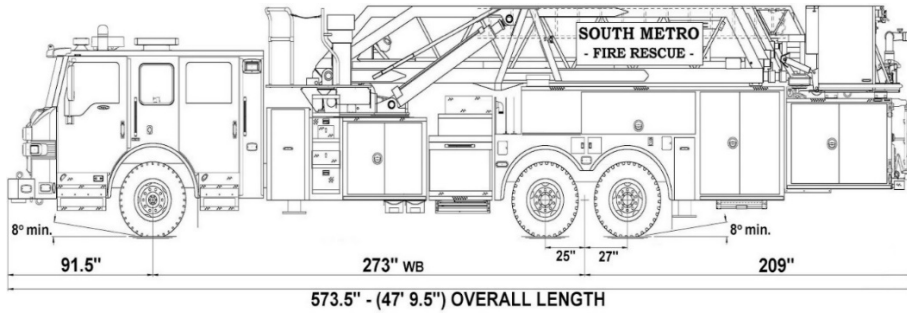

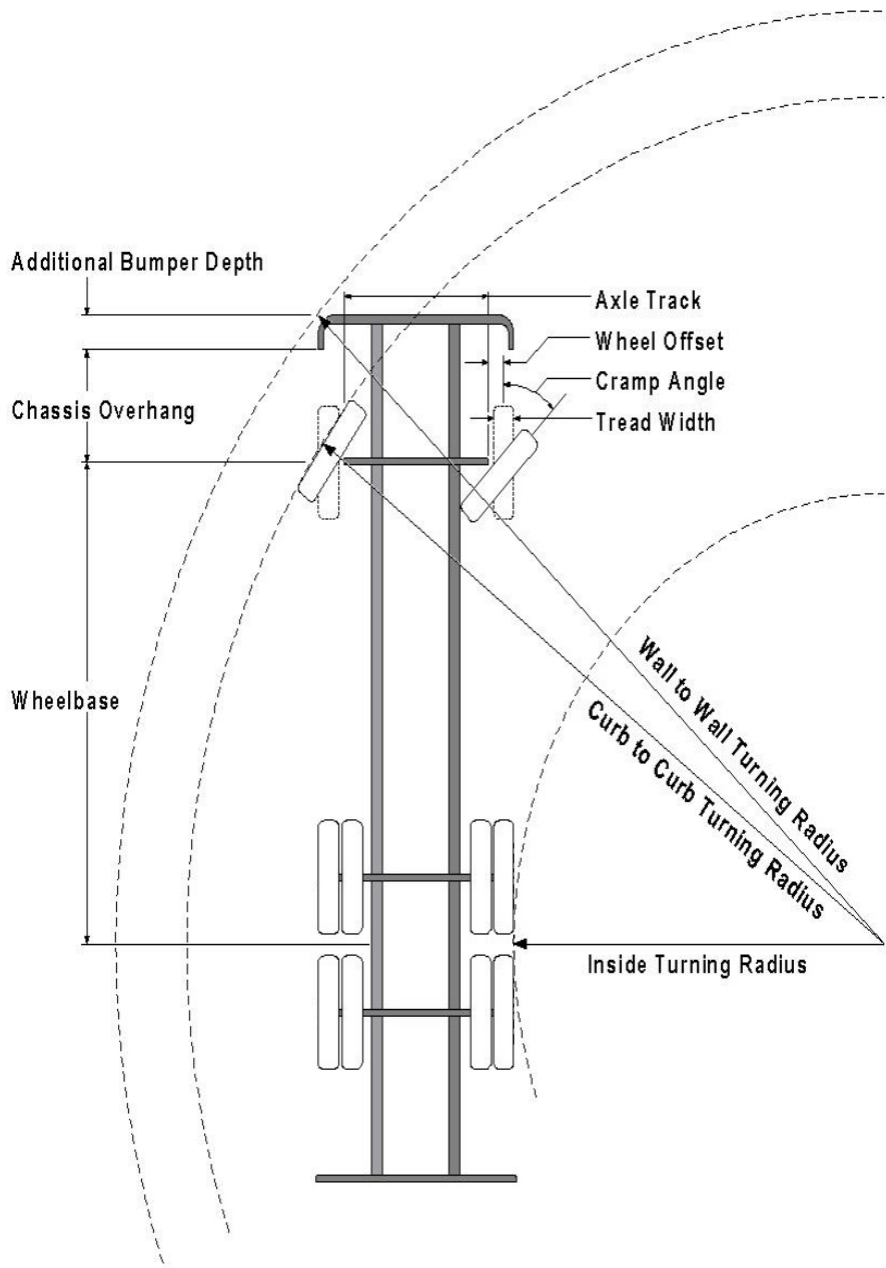

## Vehicle Specifications

Length: 47' 9.5"

Width: 8' 5" - (10' 1" mirror to mirror)

Height: 10' 9"

Wheelbase: 273 in.

Design load: 80,000 pounds

Inside Cramp Angle: 40°

Axle Track: 83"

Wheel Offset: 5.3"

Tread Width: 13.5"

### Turning Radii:

Inside Turn: 26 ft. 1 in.

Curb to curb: 41 ft. 11 in.

Wall to wall: 46 ft. 8 in.

**Where objects are present adjacent to the fire apparatus access road, particularly on turns and turn arounds which require backing, a reasonable safety margin shall be provided to prevent potential damage to the property and to the fire apparatus.**

PRIVATE ROADS that provide access to more than two dwellings or one or more commercial buildings shall be constructed to meet the roadway standards approved by the South Metro Fire Rescue Authority for fire apparatus access. Private roads that do not meet the roadway standard may be accepted provided that alternative methods and materials are incorporated into the subdivision that addresses the fire and life safety of the citizens.

## Underground Fire Line - Submittal Requirements

Reference: 2016 NFPA 24 [Installation of Private Fire Service Mains and Their Appurtenances](#)

A separate permit is required and will be issued pending review of a detailed submittal which must include the following:  
[15 IFC 901.2]

4.1.1 Working plans shall be submitted for approval to the authority having jurisdiction before any equipment is installed or replaced.

4.1.2 Deviation from approved plans shall require permission of the authority having jurisdiction.

4.1.3 Working plans shall be drawn to an indicated scale on sheets of uniform size, with a plan of each floor as applicable, and shall include the following items that pertain to the design of the system:

- (1) Name of owner
- (2) Location, including street address
- (3) Point of compass
- (4) A graphic representation of the scale used on all plans
- (5) Name and address of contractor
- (6) Size and location of all water supplies
- (7) The following items that pertain to private fire service mains:
  - (a) Size
  - (b) Length
  - (c) Location
  - (d) Material (ductile-iron, PVC., etc.)
  - (e) Point of connection to city main

- (f) Sizes, types, and locations of valves, depth at which the top of the pipe is laid below grade
- (g) Method of restraint (Meg-a-Lug or similar)

4.1.4 The working plan submittal shall include the manufacturer's installation instructions for any specially listed equipment, including descriptions, applications, and limitations for any devices, piping, or fittings. Submittals must include installation specifications for thrust blocks, corrosion protection, restraint system, bedding, detail of pipe under the building up to, and including, the flange. When it is intended that a different contractor will extend the fire line from a stopping point outside the building, to the inside flange, a second submittal and permit is required.

**All tees, plugs, reducers, valves, and hydrant branches shall be restrained against movement by thrust blocks [10.8.2] or restrained joint systems [10.8.3]. When thrust blocks are used as part of the pipe restraint system, submitted plans shall provide detailed documentation that the thrust blocks satisfy all requirements of Section 10.8.2, including specific thrust block dimensions and mathematical calculations for block dimensions per guidelines provided in Annex A.10.8.2.**

Any individual or company who physically works on or installs any part of a fire suppression system, including underground supply lines, from public water lines to system risers and backflow preventers, **must** be registered with the Colorado Division of Fire Safety. [Dept of Public Safety, Division of Fire Safety, Fire Suppression Program 8 CCR 1507-11:3.1.2] Documentation of valid annual registration may be required with plan submittal.

The following website for the Colorado Division of Fire Safety will provide registration instructions.

<http://dfs.state.co.us/SuppAppsProclnsp.htm>

All submittals must display a wet stamp and original signature by a Colorado licensed professional engineer or NICET III, or higher, in fire suppression systems. [Dept of Public Safety, Division of Fire Safety, Fire Suppression Program 8 CCR 1507

## **FIRE CODE REVIEW BLOCK**

All fire hydrants shall be installed according to water utility standards. The number and locations of the fire hydrants as shown on the Overall Utility Plan are correct as specified by the Town of Parker, Community Development Department.

---

Fire Code Official or Designated Representative

Date

(NOTE - Underground Fire Line (UFL) submittal documents must meet the requirements of NFPA 24 when submitting for review.)