
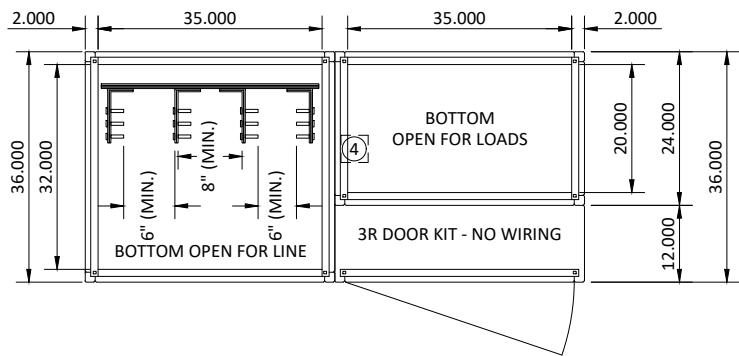
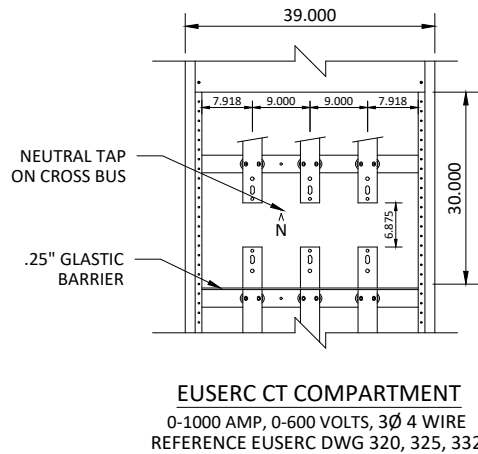
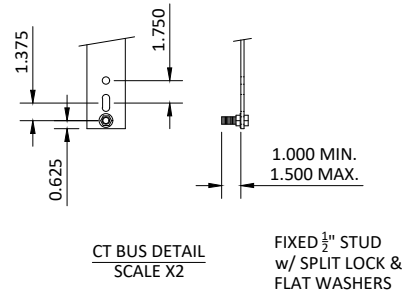
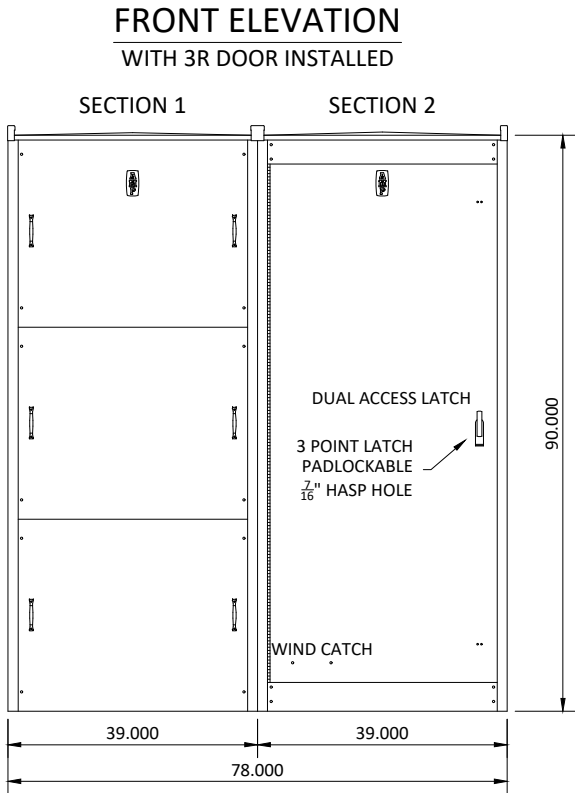


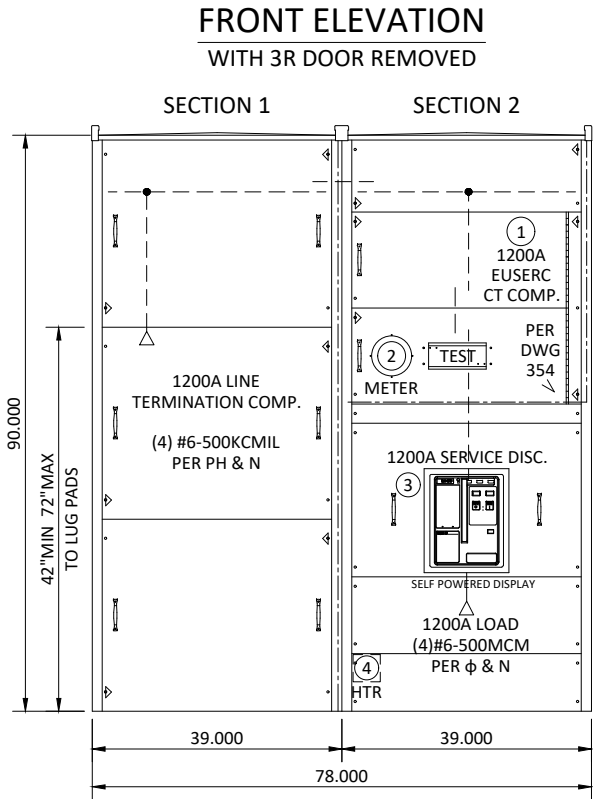

PLAN

***AHJ & UTILITY APPROVAL
REQUIRED
NOT SEISMIC RATED

- =ONE-LINE
--- =BARRIER
▷ =SEALING STUD
⦶ =CARRIAGE BOLT
S.U. = SHIPPING UNIT
SP = SPACE

(EUSERC) REQUIREMENTS
TAMPER RESISTANT FASTENERS: SEALING STUDS REQUIRED ON ALL UN-METERED COVERS ADDITIONAL NOTES: NEUTRAL MUST BE TAPPED (10-32) FOR UTILITY PROVIDED LUG

DATE	BY	DESCRIPTION
01/06/23	SMB	QUOTE

TYPE F SWITCHBOARD SPECIFICATION				
SYSTEM	AMPACITY	1200A	VOLTAGE	208Y/120
	PHASE	3PH	WIRE	4W
	FREQUENCY	60HZ	SCCR	65,000A
	BUS MAT.	AL	CONFIG	MAIN BREAKER
ENCL	TYPE	NEMA 3R, NON VENTED		
	FINISH	ASA 61 GRAY		
STANDARDS	CERTIFICATION	U.L. LISTED 891		
	SE	SUSE	SUITABLE FOR USE AS SERVICE ENTRANCE	
	UTILITY	CORE POWER		
GENERAL	FREE STANDING, FRONT ACCESSIBLE CLASS 1, DEADFRONT, FORMED 12 GA. STEEL FRAMING WITH 14 GA. STEEL PAN FORMED COVER PLATES POWDER PAINTED, TIN PLATED ALUMINUM AND/OR SILVER PLATED COPPER BUS			

SHEET TITLE	PARKER, CO
JOB NAME:	McDONALDS
DIST/CUST:	GRAYBAR
CUST PO#	47035999888

AMP AMERICAN MIDWEST POWER 3131 VICKSBURG LANE MINNEAPOLIS, MN 55447 PH (763)551-1555 FAX (763)551-9275		THIS DRAWING AND THE INFORMATION THEREON ARE THE PROPERTY OF AMERICAN MIDWEST POWER AND ARE NOT TO BE COPIED, REPRODUCED, OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF AMERICAN MIDWEST POWER	1:30 SCALE
SALES APPROVAL INITIAL:		DATE:	
QUOTE# 36670		SALESPERSON: MARK EIDEM	
JOB# ----		SHEET 1 OF 1	

BILL OF MATERIALS				
ITEM	QTY	PART NUMBER	DESCRIPTION	SUPPLIER
1	1	CT12	1200A EUSERC CT COMPARTMENT	AMP
2	1	CFI1013CT	PANEL MOUNT 13T METER SOCKET	CFI
	1	METERRINGGW-OBAR	METER RING W/O BAR	CFI
	1	MR-4	SEALING RING	CFI
3	1	SBS6123HEA10CUNMNNNNHNNBX	1200A 3P 100% RATED LSI C.B. W/ARC MAINTENANCE	EATON
4	1	17040715034	400W HEATER W/THERMOSTAT	PFANNENBERG
5				
6				
7				
8				
SEE AMP DRAWING "AMPSTL" FOR DEVICE LUG SIZES				