

## SITE LIGHTING FIXTURE SCHEDULE

NOTES:  
 1) COLOR SHALL BE DARK BRONZE, VERIFY FIXTURES AND POLES HAVE MATCHING FINISH.  
 2) INSTALL FIXTURE HEAD WITH 0° TILT TO PROVIDE FULL-CUTOFF DISTRIBUTION (NO LIGHT OUTPUT EMITTED ABOVE 90 DEGREES AT ANY LATERAL ANGLE AROUND THE FIXTURE).  
 3) COORDINATE OVERALL POLE LENGTH WITH FACTORY TO PROVIDE 25' FIXTURE MOUNTING HEIGHT WITH INCLUDING CONCRETE BASE. PROVIDE POLE MFR'S RECOMMENDED ANCHOR BOLTS.  
 POLES: SQUARE STRAIGHT STEEL POLE, COORDINATE FINAL LENGTH AND DRILL PATTERN WITH SITE ELECTRICAL CONTRACTOR.


TYPE	DESCRIPTION	FIXTURE	MANUFACTURER	CATALOG NUMBER	MOUNTING		VOLTAGE	VA	LIGHT SOURCE LAMP TYPE	NOTES
					TYPE	HEIGHT				
S1	LED POLE MOUNTED FIXTURE, TWIN HEAD @ 180 DEGREE, TYPE 3 DISTRIBUTION WITH SPILL CONTROL AND MOTION SENSOR CONTROLLED DIMMING	MCGRAW-EDISON		GALN-SA19-740-U-SL3-BZ-FF-MS/DIM-L40W	POLE	20'	208 V	88.00	LED, 4000K	1, 2 & 3
W2	LED WALL PACK	COOPER		IST-SA1D-740-U-SL2-BZ-MS/DIM-L20	SURFACE	14'	120 V	45.00	LED FURN W FIXTURE	
W2E	WALL PACK WITH BATTERY BACKUP	COOPER		IST-SA1E-740-U-SL2-BZ-CBP-MS/DIM-L20	SURFACE	14'	120 V	58.00	LED FURN W FIXTURE	

### GENERAL NOTES:



- COMPLY WITH 2020 VERSION OF NEC AS ADOPTED AND AMENDED BY THE TOWN OF PARKER, COMPLY WITH ALL OTHER APPLICABLE CODES AND STANDARDS.
- SHARED NEUTRALS ARE NOT ALLOWED FOR SINGLE PHASE BRANCH CIRCUITS.
- SEE LIGHTING CONTROL SCHEDULE ON SHEET E502.

### SITE PLAN KEY NOTES:

- UNDERGROUND SECONDARY SERVICE LATERAL, TWO 4" CONDUITS BY E.C.
- PROVIDE CORE ELECTRIC COOPERATIVE APPROVED 600AMP, 120/208V, 3-PHASE, EUSERC RATED SERVICE EQUIPMENT WITH CT COMPARTMENT, METER SOCKET AND DISCONNECT IN NEMA 3R, LOCKABLE ENCLOSURE. COORDINATE FINAL REQUIREMENTS WITH UTILITY. SEE 1E501.
- UNDERGROUND TELECOM SERVICE CONDUIT, PROVIDE (11/4" CONDUIT FROM SERVER ROOM TO SERVICE PROVIDER'S PEDESTAL UNLESS OTHERWISE REQUIRED BY SERVICE PROVIDER. COORDINATE REQUIREMENTS WITH SERVICE PROVIDER.
- PROVIDE POWER VIA LIGHTING CONTROL FOR MONUMENT SIGN. VERIFY EXACT LOCATION AND EXACT POWER REQUIREMENTS WITH SIGN VENDOR PRIOR TO ROUGH-IN.

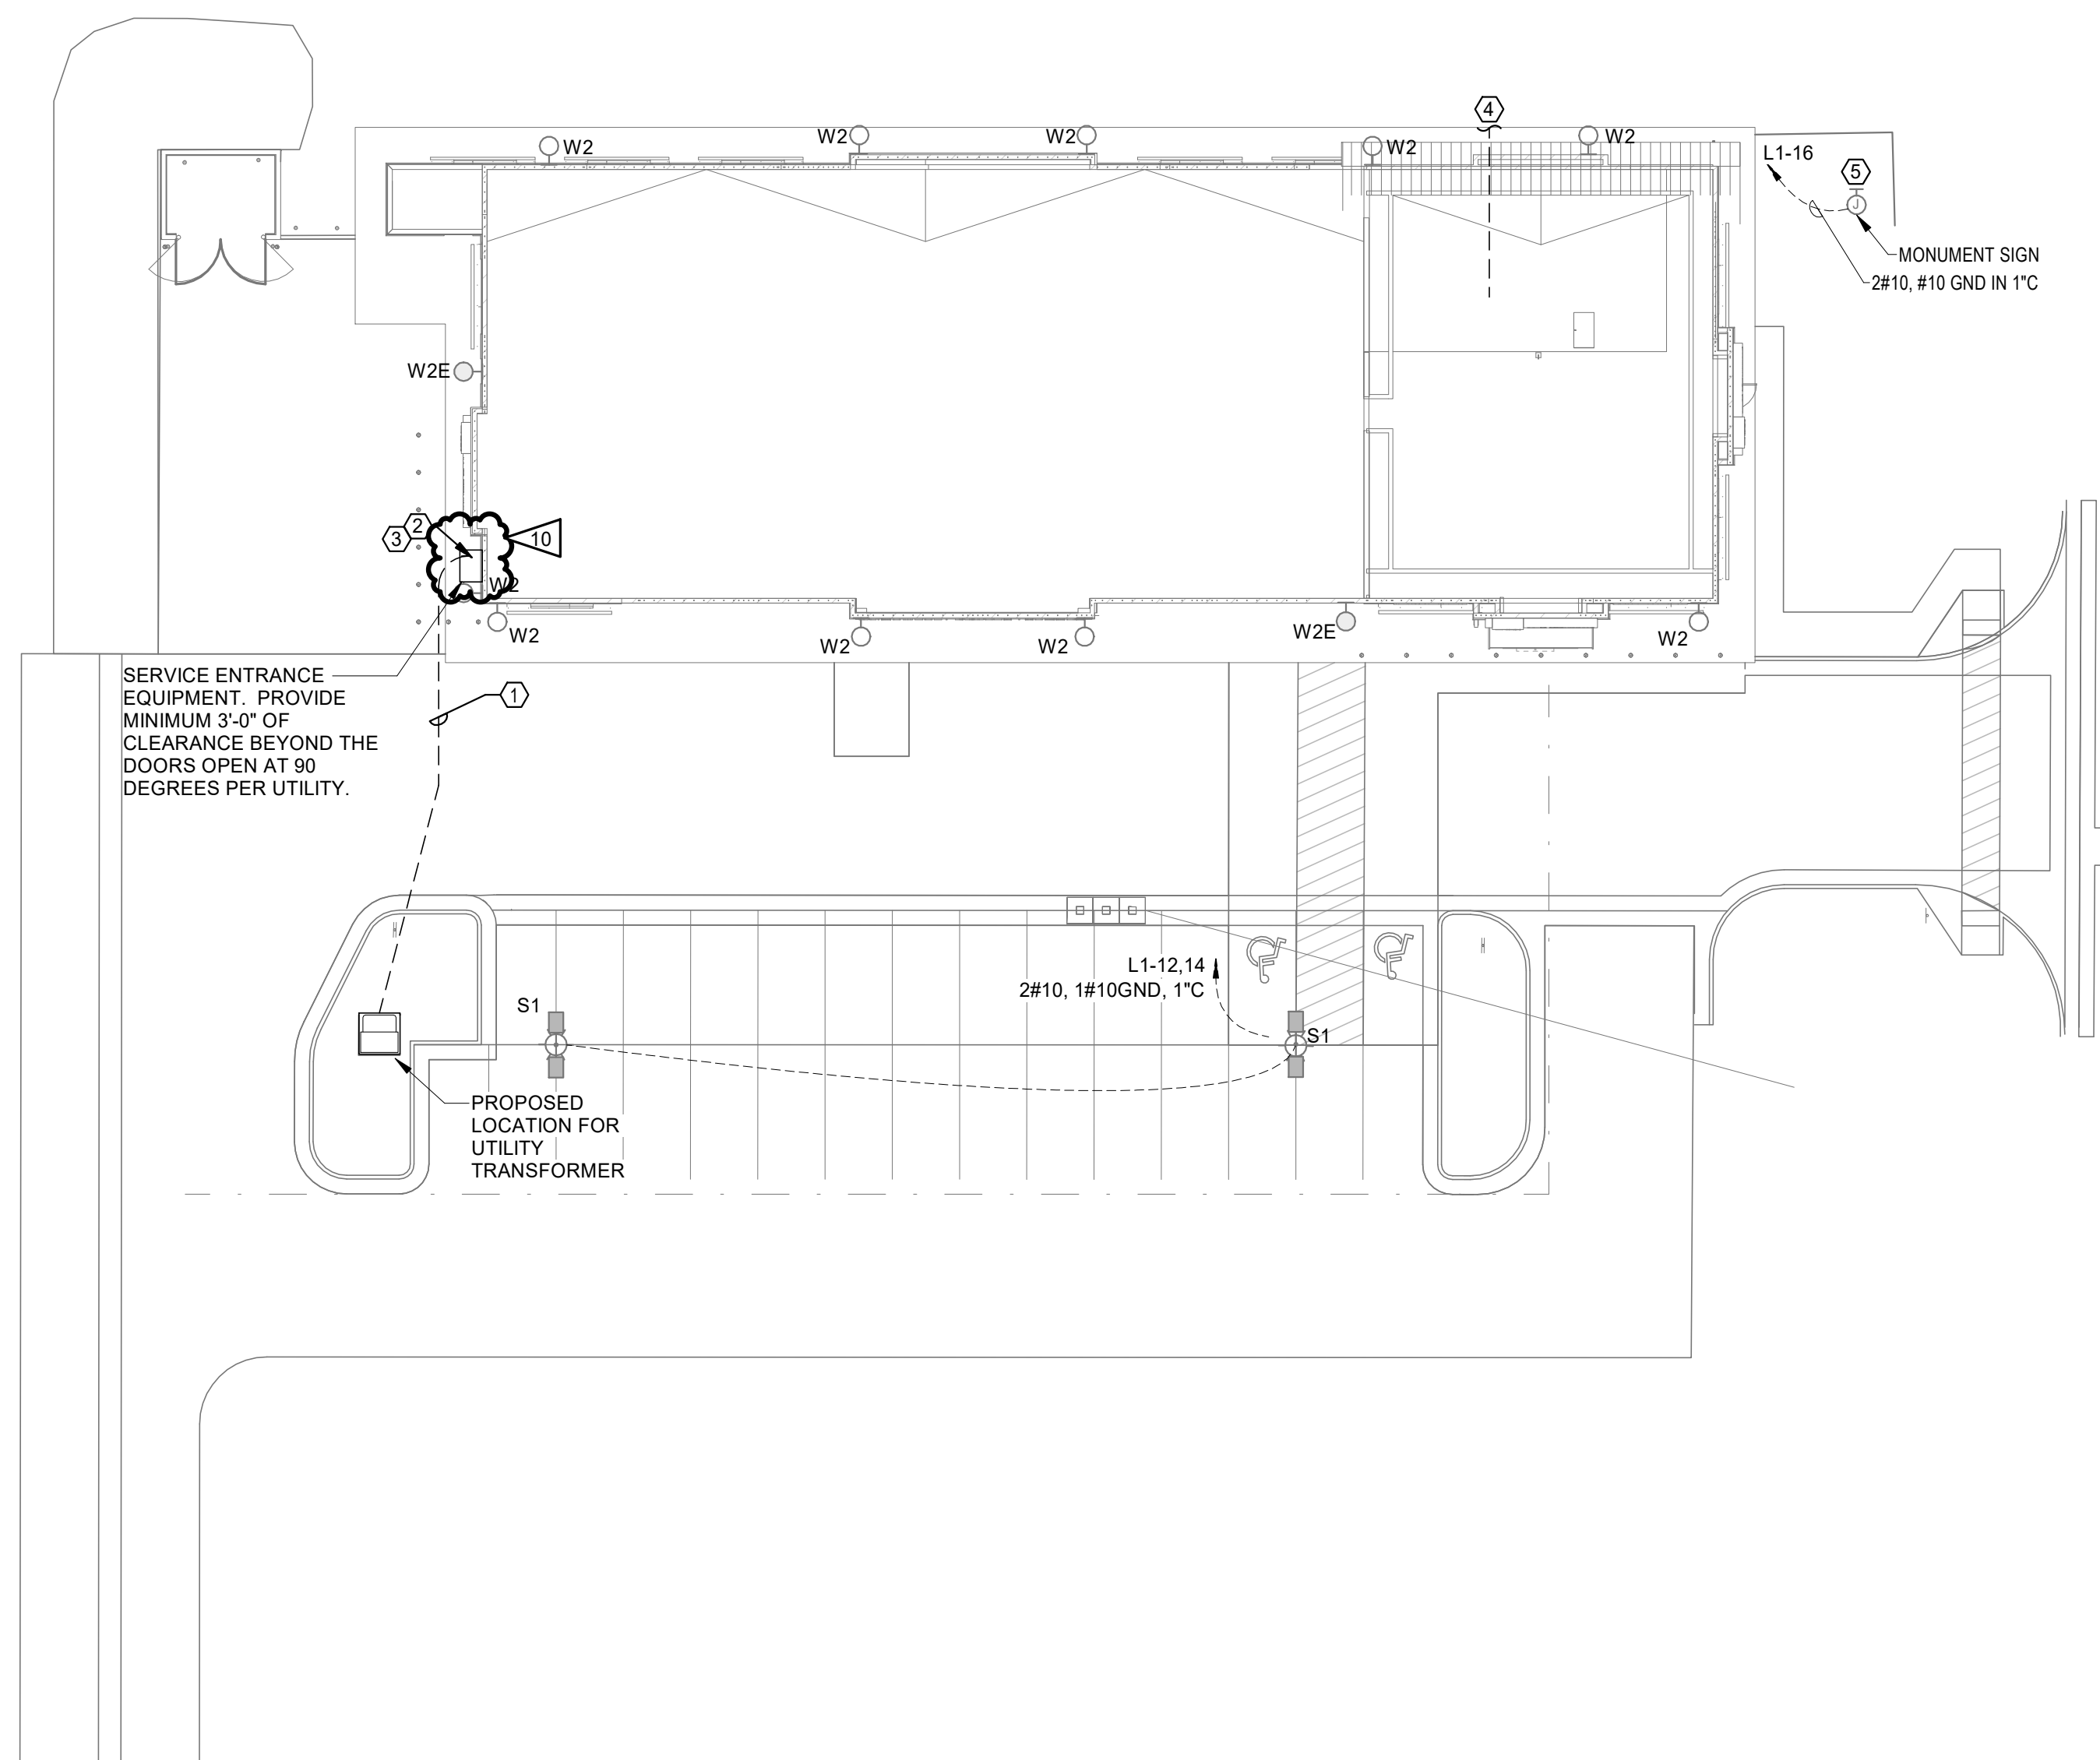

**1** ELECTRICAL SITE PLAN  
SCALE: 1" = 20'-0"

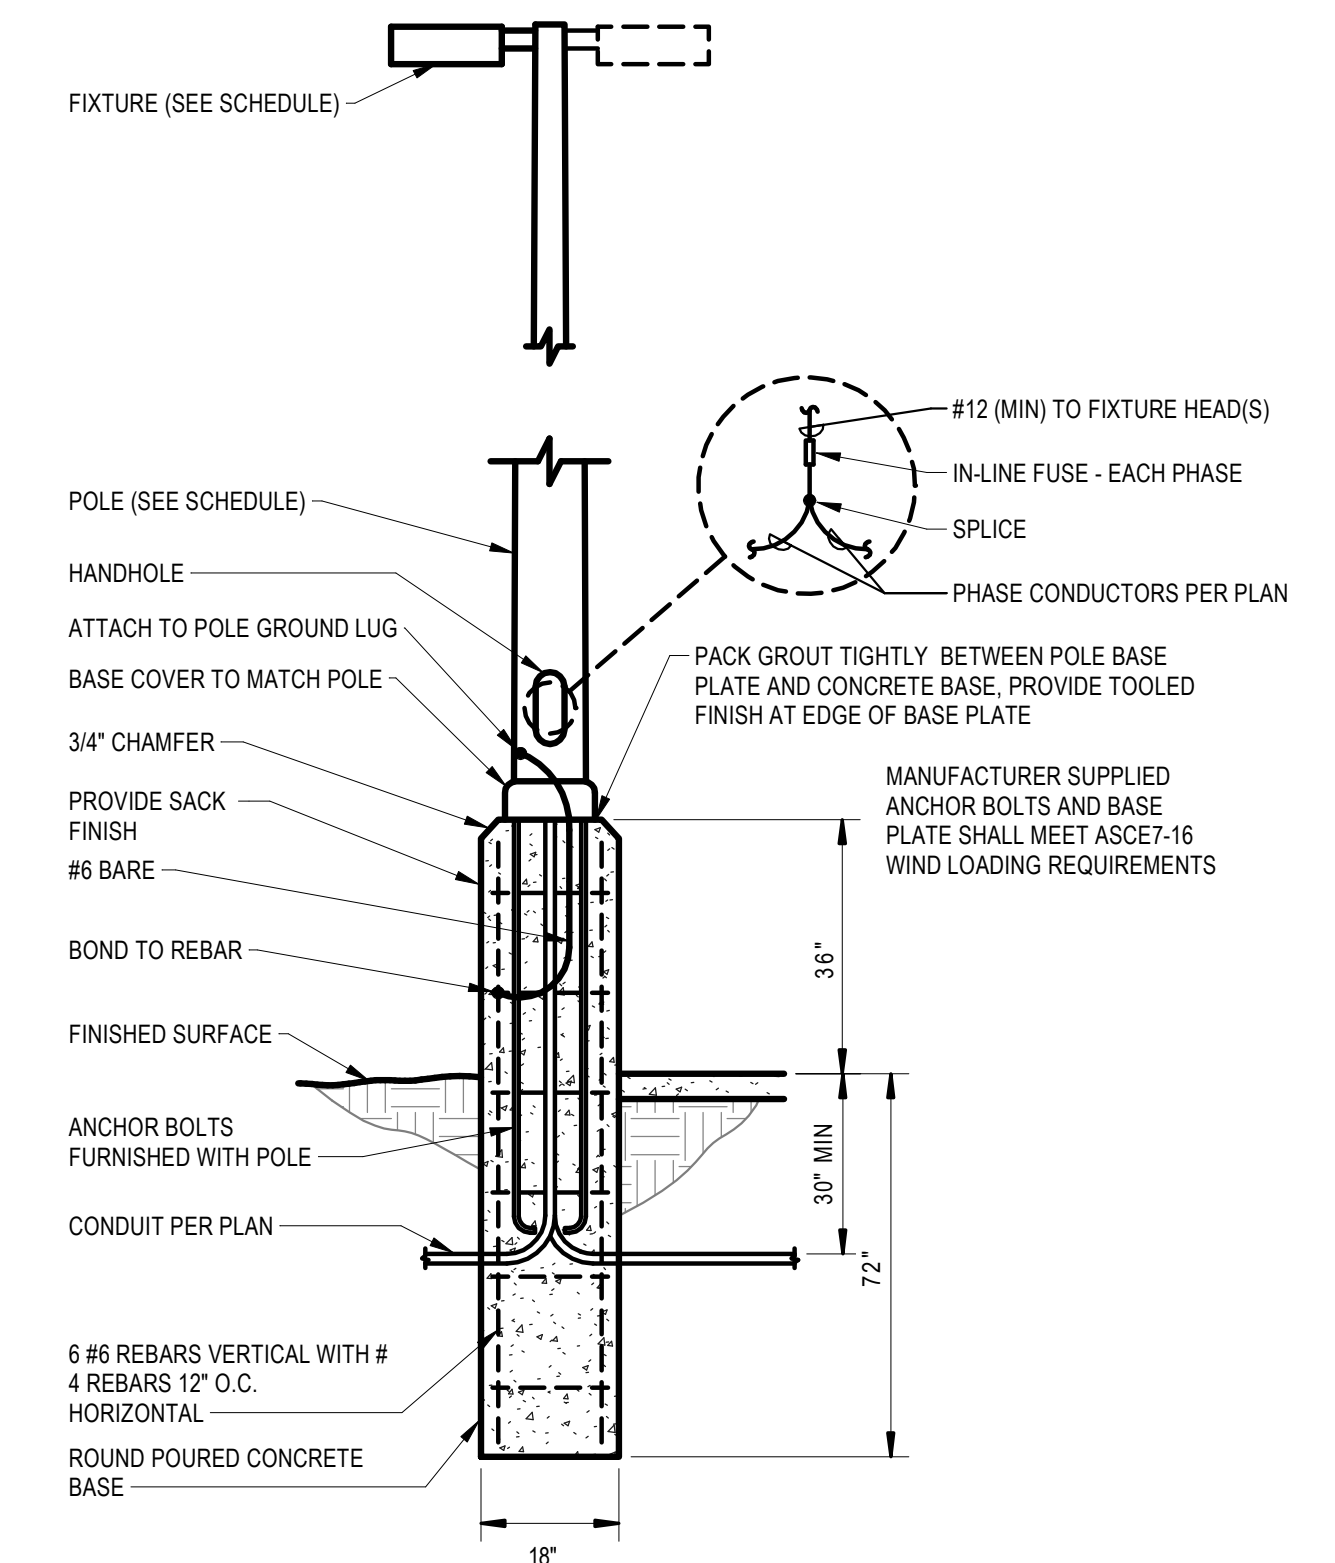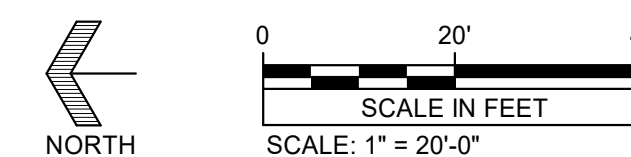

**2** POLE BASE DETAIL  
SCALE: NTS

