


PAD-MOUNTED TRANSFORMER LOCATION MAP AND MINIMUM CLEARANCES

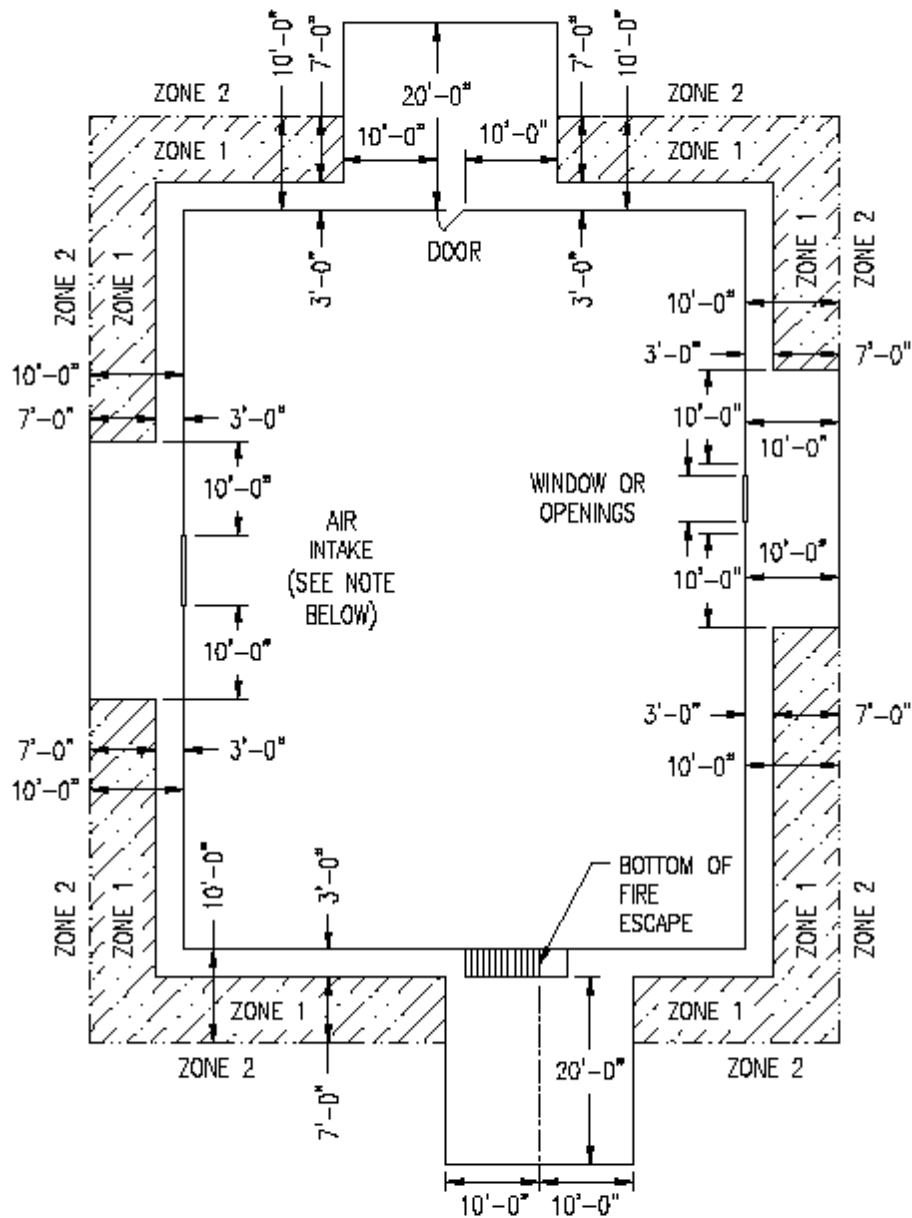




Notes:

Zone 1 (Shaded Area) = Minimum distance for pad-mounted transformer from a non-combustible building.

Zone 2 = Minimum distance for pad-mounted transformers from a combustible building.

Air intake clearance must be a minimum of 25 feet diagonal from transformer (not shown) additional clearances on page 67.

MINIMUM DISTANCES FOR PAD-MOUNT TRANSFORMERS

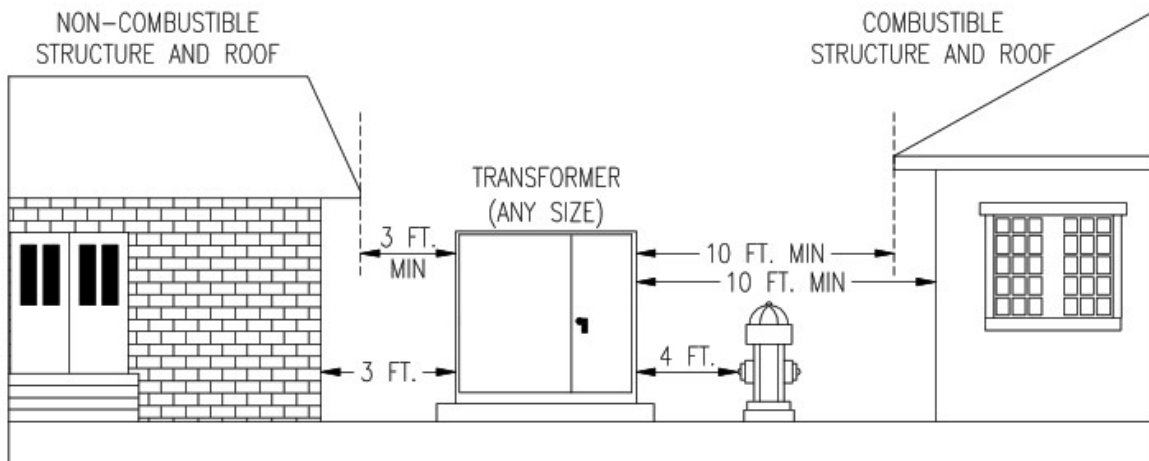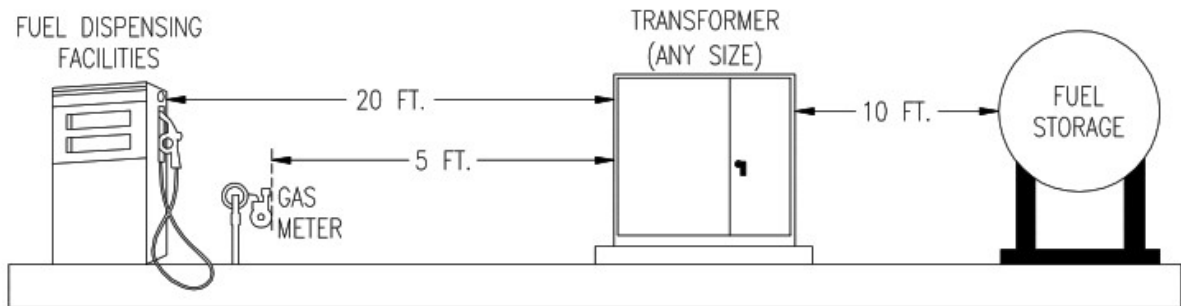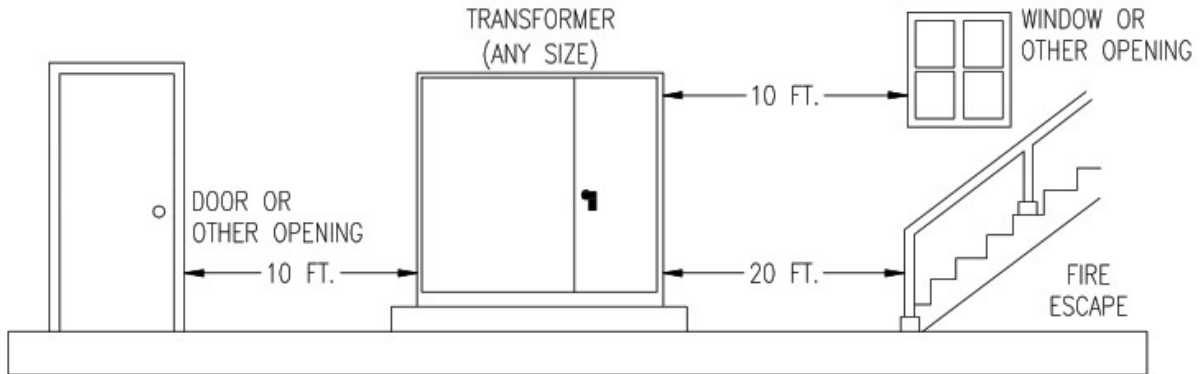

NOTE: THE MINIMUM SEPARATION DISTANCES SHOWN MAY NOT MEET INSURANCE PROPERTY LOSS PREVENTION REQUIREMENTS. BUILDER/DEVELOPER IS RESPONSIBLE FOR CONFIRMING THESE MINIMUM SEPARATION DISTANCES AND INFORMING IREA ENGINEERING PRIOR TO CONSTRUCTION IF ADDITIONAL CLEARANCES ARE NEEDED.